

Sicherheitshinweise / safety information



Vorsicht Lebensgefahr! Vor Beginn der Demontagearbeiten muss das Gerät vom Netz getrennt und vor Wiedereinschalten gesichert werden. Stillstand des Ventilatorlaufrades abwarten!


Caution, risk of death! Before starting the dismantling work, the ventilation unit must be disconnected from the power supply and secured from being switched on again. Wait for the fan impeller to stop!




Das Gerät ist zu einem großen Teil aus Blech gefertigt und weist produktionsbedingt scharfkantige Bauteile auf. Diese stellen bei bestimmungsgemäßer Nutzung keine Behinderung oder Verletzungsrisiko dar. Bei der Demontage kann der Kontakt mit diesen Bauteilen jedoch zu Verletzungen führen. Monteure sollten daher stets Schutzhandschuhe bei den Arbeiten am Gerät tragen.

The device is mainly made of sheet metal, including sharp edges. For its intended use these do not pose any risk of injury. However, contact with these components can lead to injuries during disassembly. Therefore, installers should always wear protective gloves when working on the device.

Mineralwolle vom Blech trennen / *separate mineral wool from iron housing*

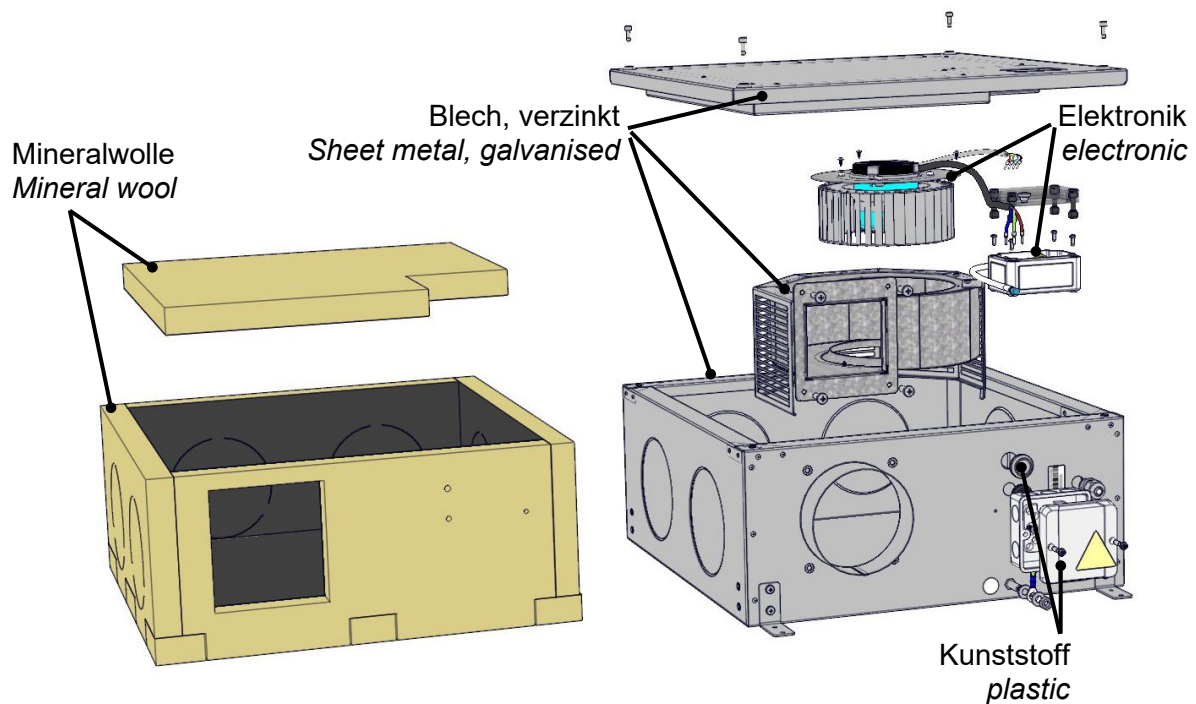

Druckregelung demontieren / *disassemble pressure control*

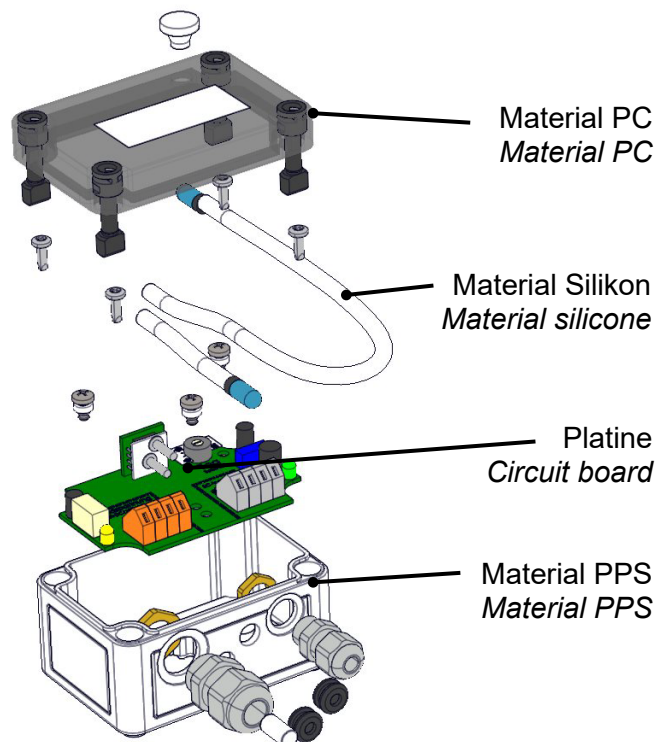

Hersteller / Manufacturer:
ZLT Lüftungs- und Brandschutztechnik GmbH, Wilhermsdorfer Straße 28, 09387 Jahnsdorf/Erzgeb. DEUTSCHLAND, www.zlt.de